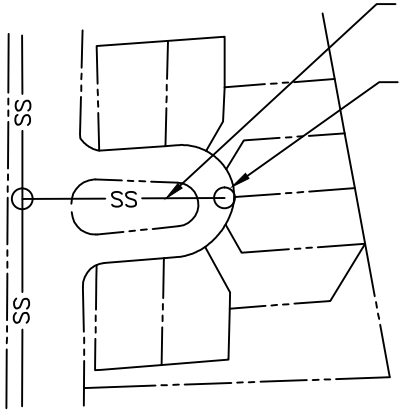

WATER AND SEWER LINES SHALL BE LAID OUTSIDE OF PAVEMENT WHEREVER POSSIBLE

SEWER MANHOLES SHALL BE CONSTRUCTED NEAR PROPERTY CORNERS AND STREET RIGHT-OF-WAY INTERSECTIONS.

COURT

FIRE HYDRANTS SHALL BE PLACED ON RIGHT-OF-WAY LINE AND PROPERTY LINE INTERSECTIONS WHEN POSSIBLE.

SEWER LINES SHALL END AT STANDARD MANHOLES OUTSIDE OF PAVEMENT

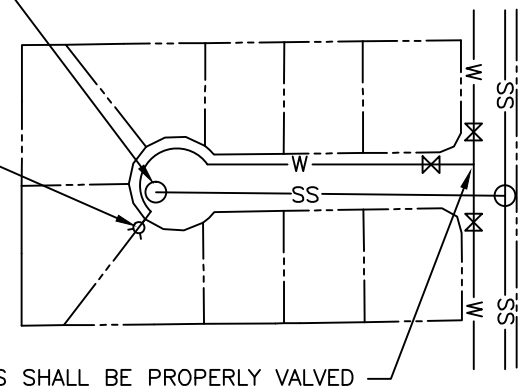

ALL INTERSECTIONS SHALL BE PROPERLY VALVED SO THAT MAINTENANCE WILL BE FACILITATED.

CUL-DE-SAC

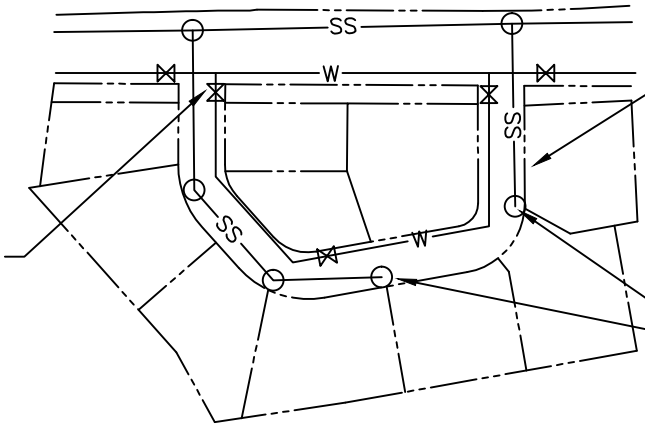

RIGHT-OF-WAY (TYP.)

WATER LINES SHALL BE LOOPED. OR SHALL END WITH FIRE HYDRANT. (6" OR LARGER MAINS) OR BLOW-OFF HYDRANT (SMALLER THAN 6" MAINS)

WATER LINES SHALL BE VALVED SO AS TO PREVENT MINIMUM DISRUPTION TO SERVICE DURING MAINTENANCE.

NOTE: SEE DETAL WS1 FOR WATER AND SEWER SEPARATION REQUIREMENTS

SEWER MANHOLES SHALL BE CONSTRUCTED NEAR PROPERTY CORNERS AND STREET RIGHT-OF-WAY INTERSECTIONS.

LOOP

GENERAL WATER AND SEWER REQUIREMENTS

STANDARD CONSTRUCTION DETAILS

CITY OF Savannah
WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.
DATED: SEP 2013
PLATE NUMBER: WS2