


4" PVC C-900 ONLY

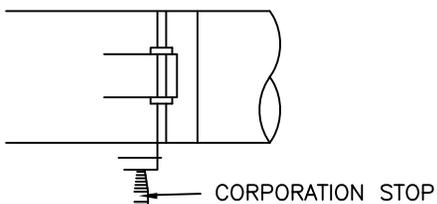

NOTES:

1. TAPPING SADDLE TO BE DUCTILE IRON WITH TYPE 304 STAINLESS STEEL FORGED DOUBLE STRAPS, STAINLESS STEEL BOLTS, NUTS, AND WASHERS. FINISH IS FUSION BONDED NYLON TO AVERAGE THICKNESS OF 12MILS.
2. CORPORATION STOP MUST BE PLACED AT 45° WITH RESPECT TO WATER MAIN (AS SHOWN ABOVE).
3. ALL 1" AND 2" TAPS ON WATER LINES SMALLER THAN 6"(SIX INCHES) WILL REQUIRE A TAPPING SADDLE. ALL TWO INCH (2") TAPS WILL REQUIRE A TAPPING SADDLE, REGARDLESS OF WATER MAIN SIZE.
3. ALL PIPES USED FOR RECLAIMED WATER SHALL BE COLOR PURPLE.

STANDARD CONSTRUCTION
DETAILS



1" & 2" RECLAIMED WATER TAPPING SADDLE

PLATE NUMBER:

R3

APPROVED:

SIGNATURE ON FILE

CITY ENGINEER

SCALE: N.T.S.

DATE: DECEMBER 2005