


- NOTE:
1. THE TAPPING SLEEVE AND VALVE MUST BE INSTALLED IN A MANHOLE. SEE DETAIL R6 AND R7 FOR THE MANHOLE DETAIL
  2. ALL PIPES USED FOR RECLAIMED WATER SHALL BE COLOR PURPLE.



PLAN VIEW

# STANDARD CONSTRUCTION DETAILS

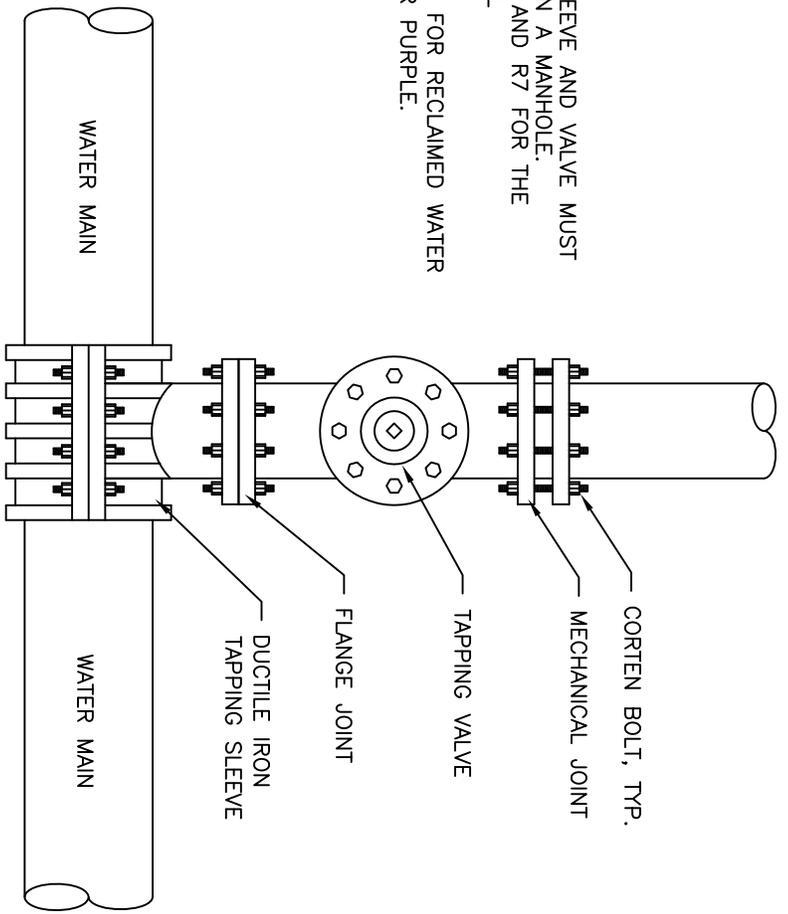

## TYPICAL RECLAIMED WATER TAPPING SLEEVE

APPROVED: \_\_\_\_\_  
SIGNATURE ON FILE  
CITY ENGINEER

SCALE: N.T.S.  
DATED: DECEMBER 2005

PLATE NUMBER:

R9