


SECTION

NOTES:

1. MANHOLE FRAME AND COVER SHALL BE NEENAH FOUNDRY CO, CATALOG NO. R-1668, TYPE C, LABELED "RECLAIMED WATER".
2. THE BOTTOM OF THE MANHOLE FRAME SHALL NOT BE MORE THAN 12" ABOVE THE TOP OF THE MANHOLE STRUCTURE.
3. PRECAST CONCENTRIC CONE RISERS MAY BE USED WHERE REQUIRED FOR DEPTH.
4. THE MANHOLE FRAME AND COVER MUST BE CENTERED OVER THE VALVE.
5. POLYPROPYLENE MANHOLE STEPS SHALL BE PROVIDED AT 12" O.C. FOR MANHOLES GREATER THAN 4 FEET DEEP.
6. THE AIR RELIEF VALVE SHALL BE SIZED IN ACCORDANCE WITH THE DESIGN REQUIREMENTS
7. ALL PIPES USED FOR RECLAIMED WATER SHALL BE COLOR PURPLE.

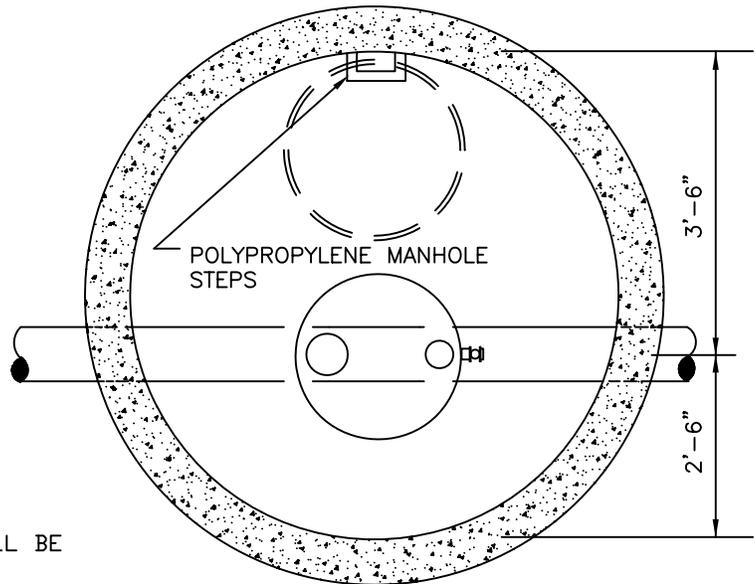

PLAN

STANDARD CONSTRUCTION
DETAILS



AIR RELIEF VALVE INSTALLATION

PLATE NUMBER:

R10

APPROVED:

SIGNATURE ON FILE

CITY ENGINEER

SCALE: N.T.S.

DATE: DECEMBER 2005