


NOTES:

1. METER (CLASS II) SHALL HAVE U.L. APPROVED STRAINERS.
2. COMPLETE BY-PASS ASSEMBLY IS REQUIRED ON ALL METERS.
3. THE BYPASS AND ALL VALVES ARE TO BE INSTALLED INSIDE METER PIT.
4. INSPECTION LID SHALL BE INSTALLED SUCH THAT ALL METER REGISTERS CAN BE READ WITHOUT REMOVING THE ENTIRE METER PIT LID.
5. THE TEST TEE OR TEE SERVICE SADDLE SHALL NOT BE REQUIRED IF THE METER IS EQUIPPED WITH A TEST PORT.
6. ALL MATERIAL SHALL BE NO-LEAD BRASS OR COPPER.
7. A MINIMUM 15" CLEARANCE IS NEEDED BETWEEN ALL FLANGES AND THE METER PIT.
8. OPTIONAL QUAZITE OR CDR VAULT (4'X6' MIN.) CAN BE USED.
9. THE METER PIT SHALL BE SIZED AS REQUIRED TO HOUSE THE EQUIPMENT.
10. 3/8" ALUMINUM FLOOR PLATE GRID PATTERN COVER & FRAME TO SUPPORT 150 LB./SQ. FT. ALL SURFACES TO BE PAINTED FLAT BLACK.

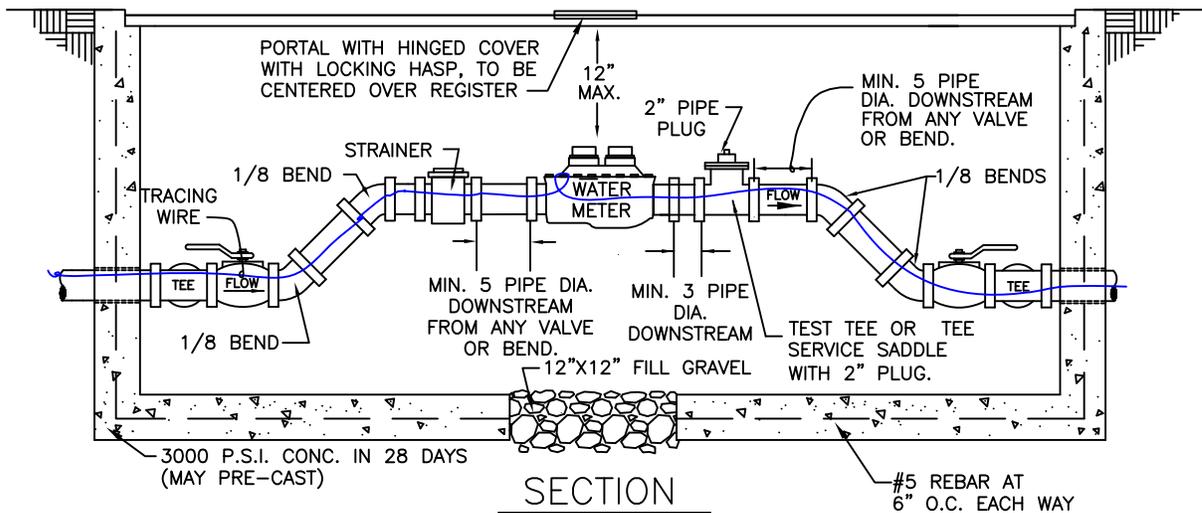

2" WATER METER INSTALLATION

STANDARD
CONSTRUCTION
DETAILS



CITY OF
savannah
WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.
DATED: JAN 2017
PLATE NUMBER:
W5A