


PROFILE

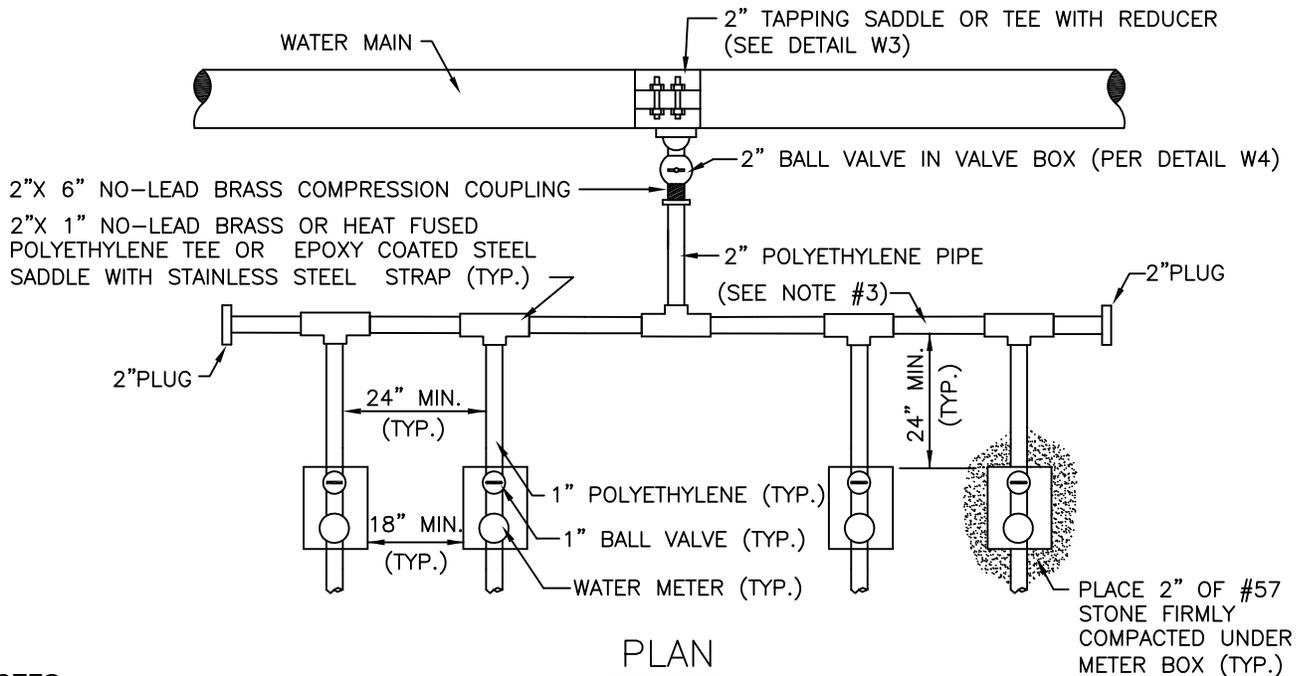


PLAN

NOTES:

1. ALL METERS SHALL BE INSTALLED WITHIN CITY OF SAVANNAH RIGHT OF WAY OR EASEMENT.
2. VALVE BOX PER DETAIL W4.
3. A 2" PIPE MAY BE USED FOR UP TO SIX (6) UNITS. 2" PIPE SHALL BE POLYETHYLENE.
4. AN APPROVED BACKFLOW PREVENTOR MUST BE INSTALLED APPROPRIATE FOR THE BUILDING USE IN ACCORDANCE WITH THE CITY'S STANDARDS. THE USE OF A SINGLE BACKFLOW PREVENTOR UPSTREAM OF THE METER MANIFOLD MAY BE ALLOWED, IF APPROVED BY THE CITY FOR THE PROPOSED USE.

MANIFOLD FOR MULTIPLE METER INSTALLATION

STANDARD CONSTRUCTION DETAILS



CITY OF *savannah*

WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.

DATED: JAN 2017

PLATE NUMBER:

W7