



NOTES:

1. MANHOLE FRAME AND COVER PER DETAIL W27
2. THE BOTTOM OF THE MANHOLE FRAME SHALL NOT BE MORE THAN 12" ABOVE THE TOP OF THE MANHOLE STRUCTURE.
3. PRECAST CONCENTRIC CONE RISERS MAY BE USED WHERE REQUIRED FOR DEPTH.
4. THE MANHOLE FRAME AND COVER MUST BE CENTERED OVER THE VALVE OPERATING NUT.
5. POLYPROPYLENE MANHOLE STEPS SHALL BE PROVIDED AT 12" O.C. FOR MANHOLES GREATER THAN 5 FEET DEEP.

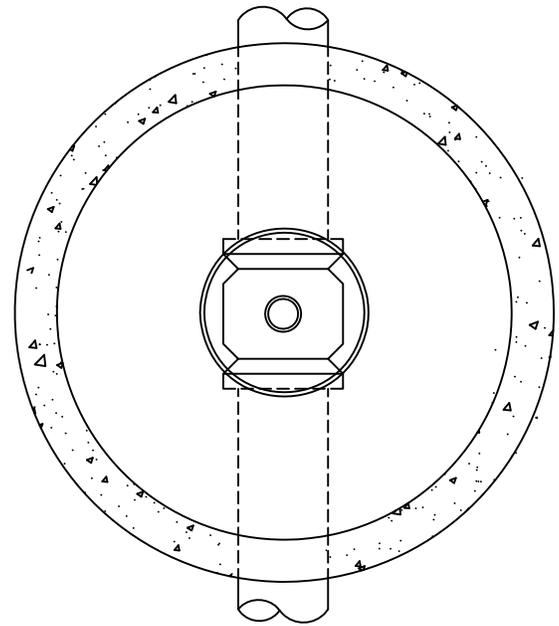

PLAN

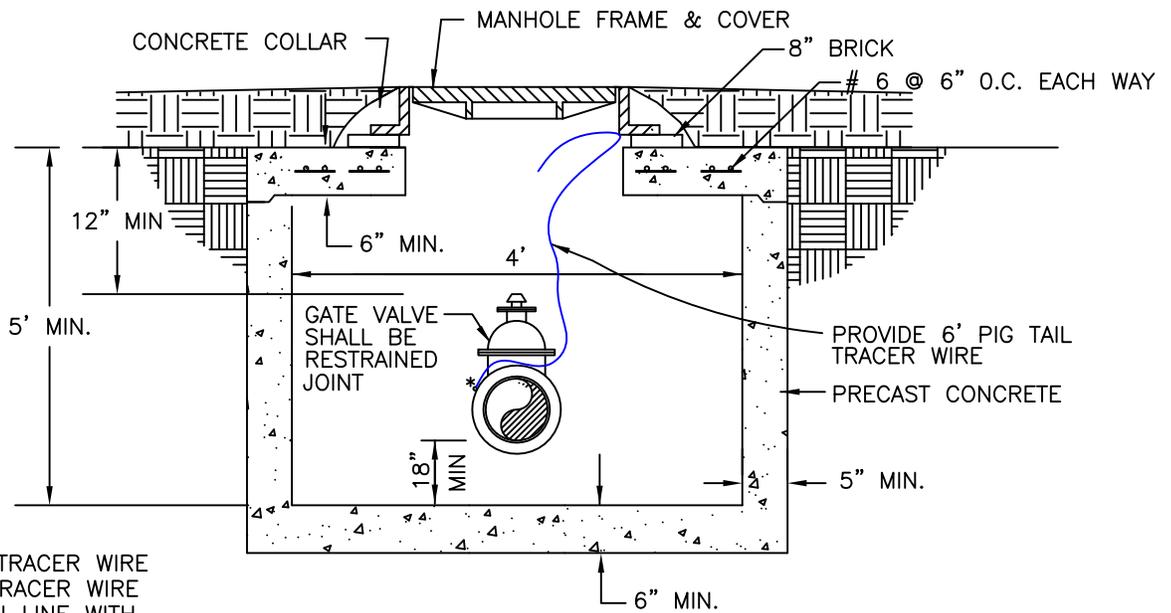

\* CONNECT TRACER WIRE PIGTAIL TO TRACER WIRE ON THE MAIN LINE WITH SPLICE CONNECTOR

SECTION

VALVE MANHOLE FOR 4"–8" GATE VALVES

STANDARD  
CONSTRUCTION  
DETAILS



CITY OF  
*Savannah*  
WATER RESOURCES AND PUBLIC WORKS BUREAU  
Planning & Engineering

SCALE: N.T.S.  
DATED: JAN 2017  
PLATE NUMBER:  
W25A