
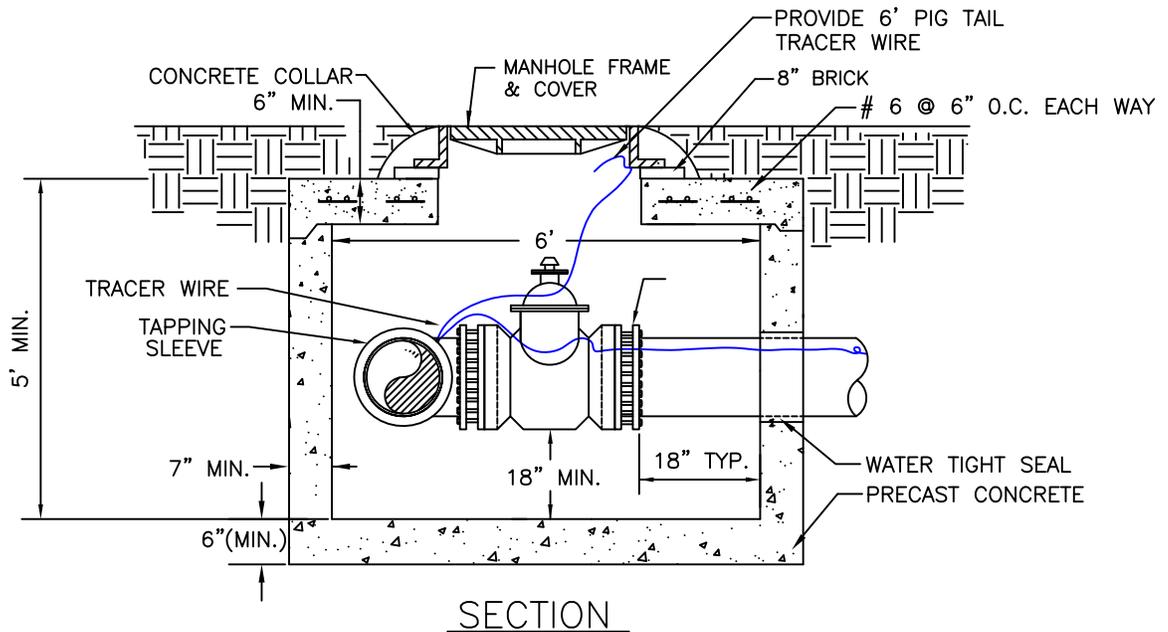



NOTES:

1. MANHOLE FRAME AND COVER PER DETAIL W27.
2. THE BOTTOM OF THE MANHOLE FRAME SHALL NOT BE MORE THAN 12" ABOVE THE TOP OF THE MANHOLE STRUCTURE.
3. PRECAST CONCENTRIC CONE RISERS MAY BE USED WHERE REQUIRED FOR DEPTH.
4. THE MANHOLE FRAME AND COVER MUST BE CENTERED OVER THE VALVE OPERATING NUT.
5. POLYPROPYLENE MANHOLE STEPS SHALL BE PROVIDED AT 12" O.C. FOR MANHOLES GREATER THAN 5 FEET DEEP.
6. TAPPING SLEEVE AND VALVE PER DETAIL W24.
7. CONNECT TO EXIST TRACER WIRE W/ SPLICE CONNECTOR.

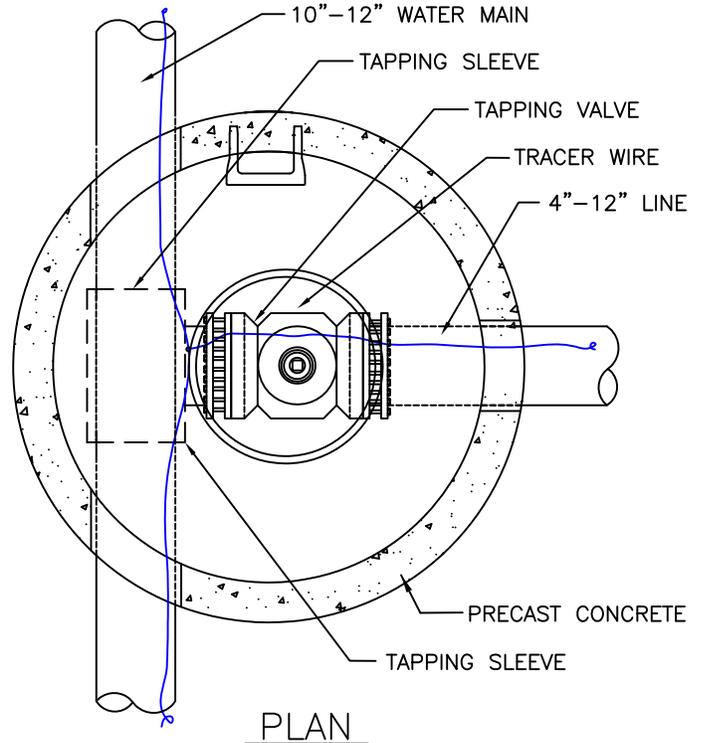

VALVE MANHOLE FOR 10" & 12" TAPPING SLEEVES & VALVES

STANDARD
CONSTRUCTION
DETAILS



CITY OF
savannah
WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.
DATED: JAN 2017
PLATE NUMBER:
W25D