



NOTES:

1. EXPOSED CORPORATION STOP SHALL BE SECURELY LOCKED AT ALL TIMES.
2. BURIED CORPORATION STOP SHALL BE TURNED OFF, BLOW OFF REMOVED, AND CORPORATION STOP PLUGGED WITH A NO-LEAD BRASS PLUG AFTER WATER SAMPLES HAVE PASSED.
3. THE SAMPLING STATION MUST BE SUPPORTED A MINIMUM OF 18" ABOVE GROUND.
4. SERVICE LATERALS MAY BE USED AS TEMPORARY SAMPLING STATIONS IF THE SAME RISER CONFIGURATION IS INSTALLED FOR TEMPORARY USE.

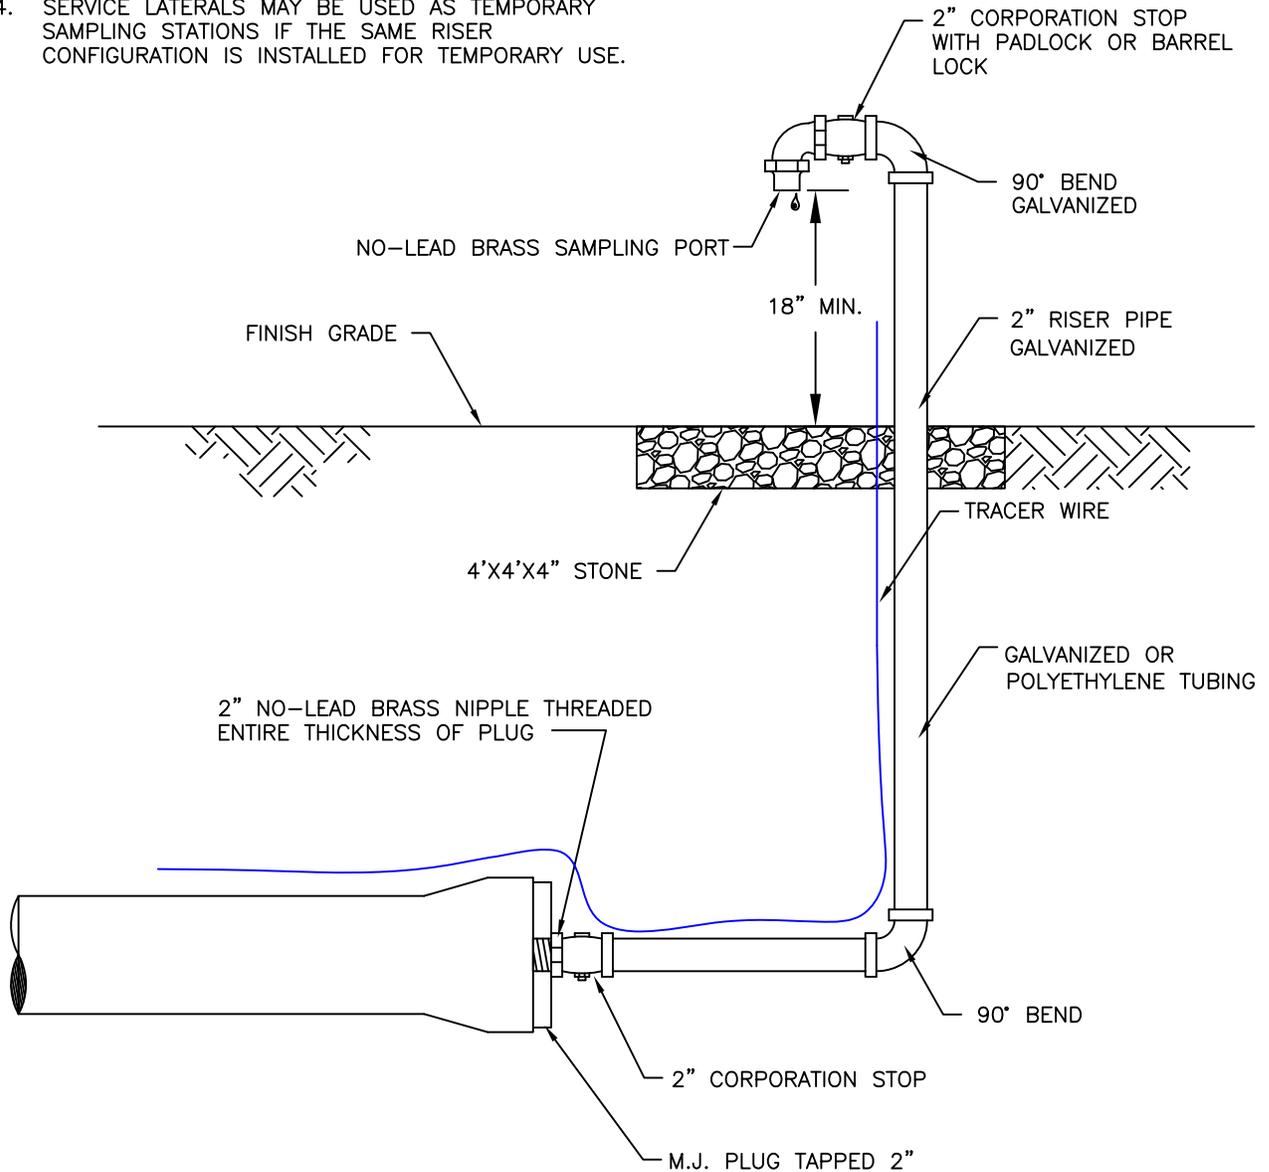

TEMPORARY SAMPLING STATION

STANDARD
CONSTRUCTION
DETAILS



CITY OF
savannah
WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.
DATED: JAN 2017
PLATE NUMBER:
W42