


PLAN

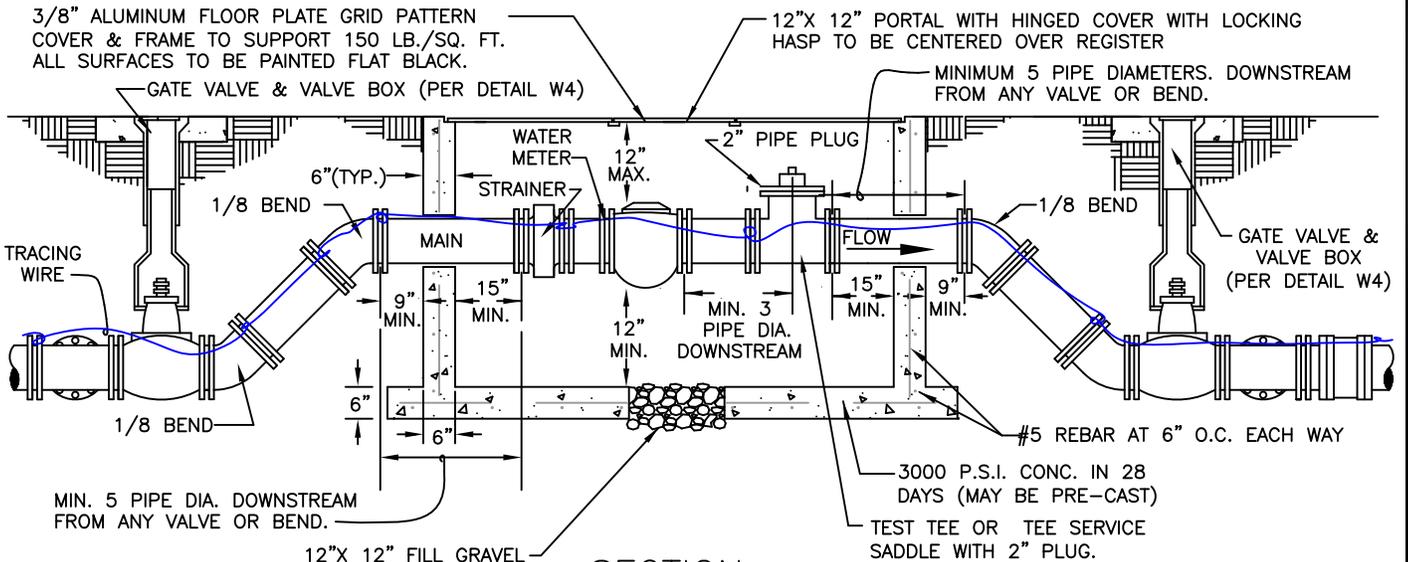

SECTION

NOTES:

1. METER (CLASS II) SHALL HAVE U.L. APPROVED STRAINERS.
2. COMPLETE BY-PASS ASSEMBLY IS REQUIRED ON ALL METERS.
3. VALVES SHALL BE MECHANICAL JOINT OR FLANGED GATE VALVES.
4. ALL JOINTS FROM TEE TO TEE SHALL BE RESTRAINED.
5. INSPECTION LID SHALL BE INSTALLED SUCH THAT ALL METER REGISTERS CAN BE READ WITHOUT REMOVING THE ENTIRE METER PIT LID.
6. THE TEST TEE OR TEE SERVICE SADDLE SHALL NOT BE REQUIRED IF THE METER IS EQUIPPED WITH A TEST PORT.
7. THE METER PIT SHALL BE SIZED AS REQUIRED TO HOUSE THE EQUIPMENT.
8. OPTIONAL QUAZITE OR CDR VAULT CAN BE USED.

WATER METER INSTALLATION 3" AND LARGER

STANDARD
CONSTRUCTION
DETAILS



CITY OF
savannah
WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.

DATED: JAN 2017

PLATE NUMBER:

W5B